




# Thermal Expansion Modifications

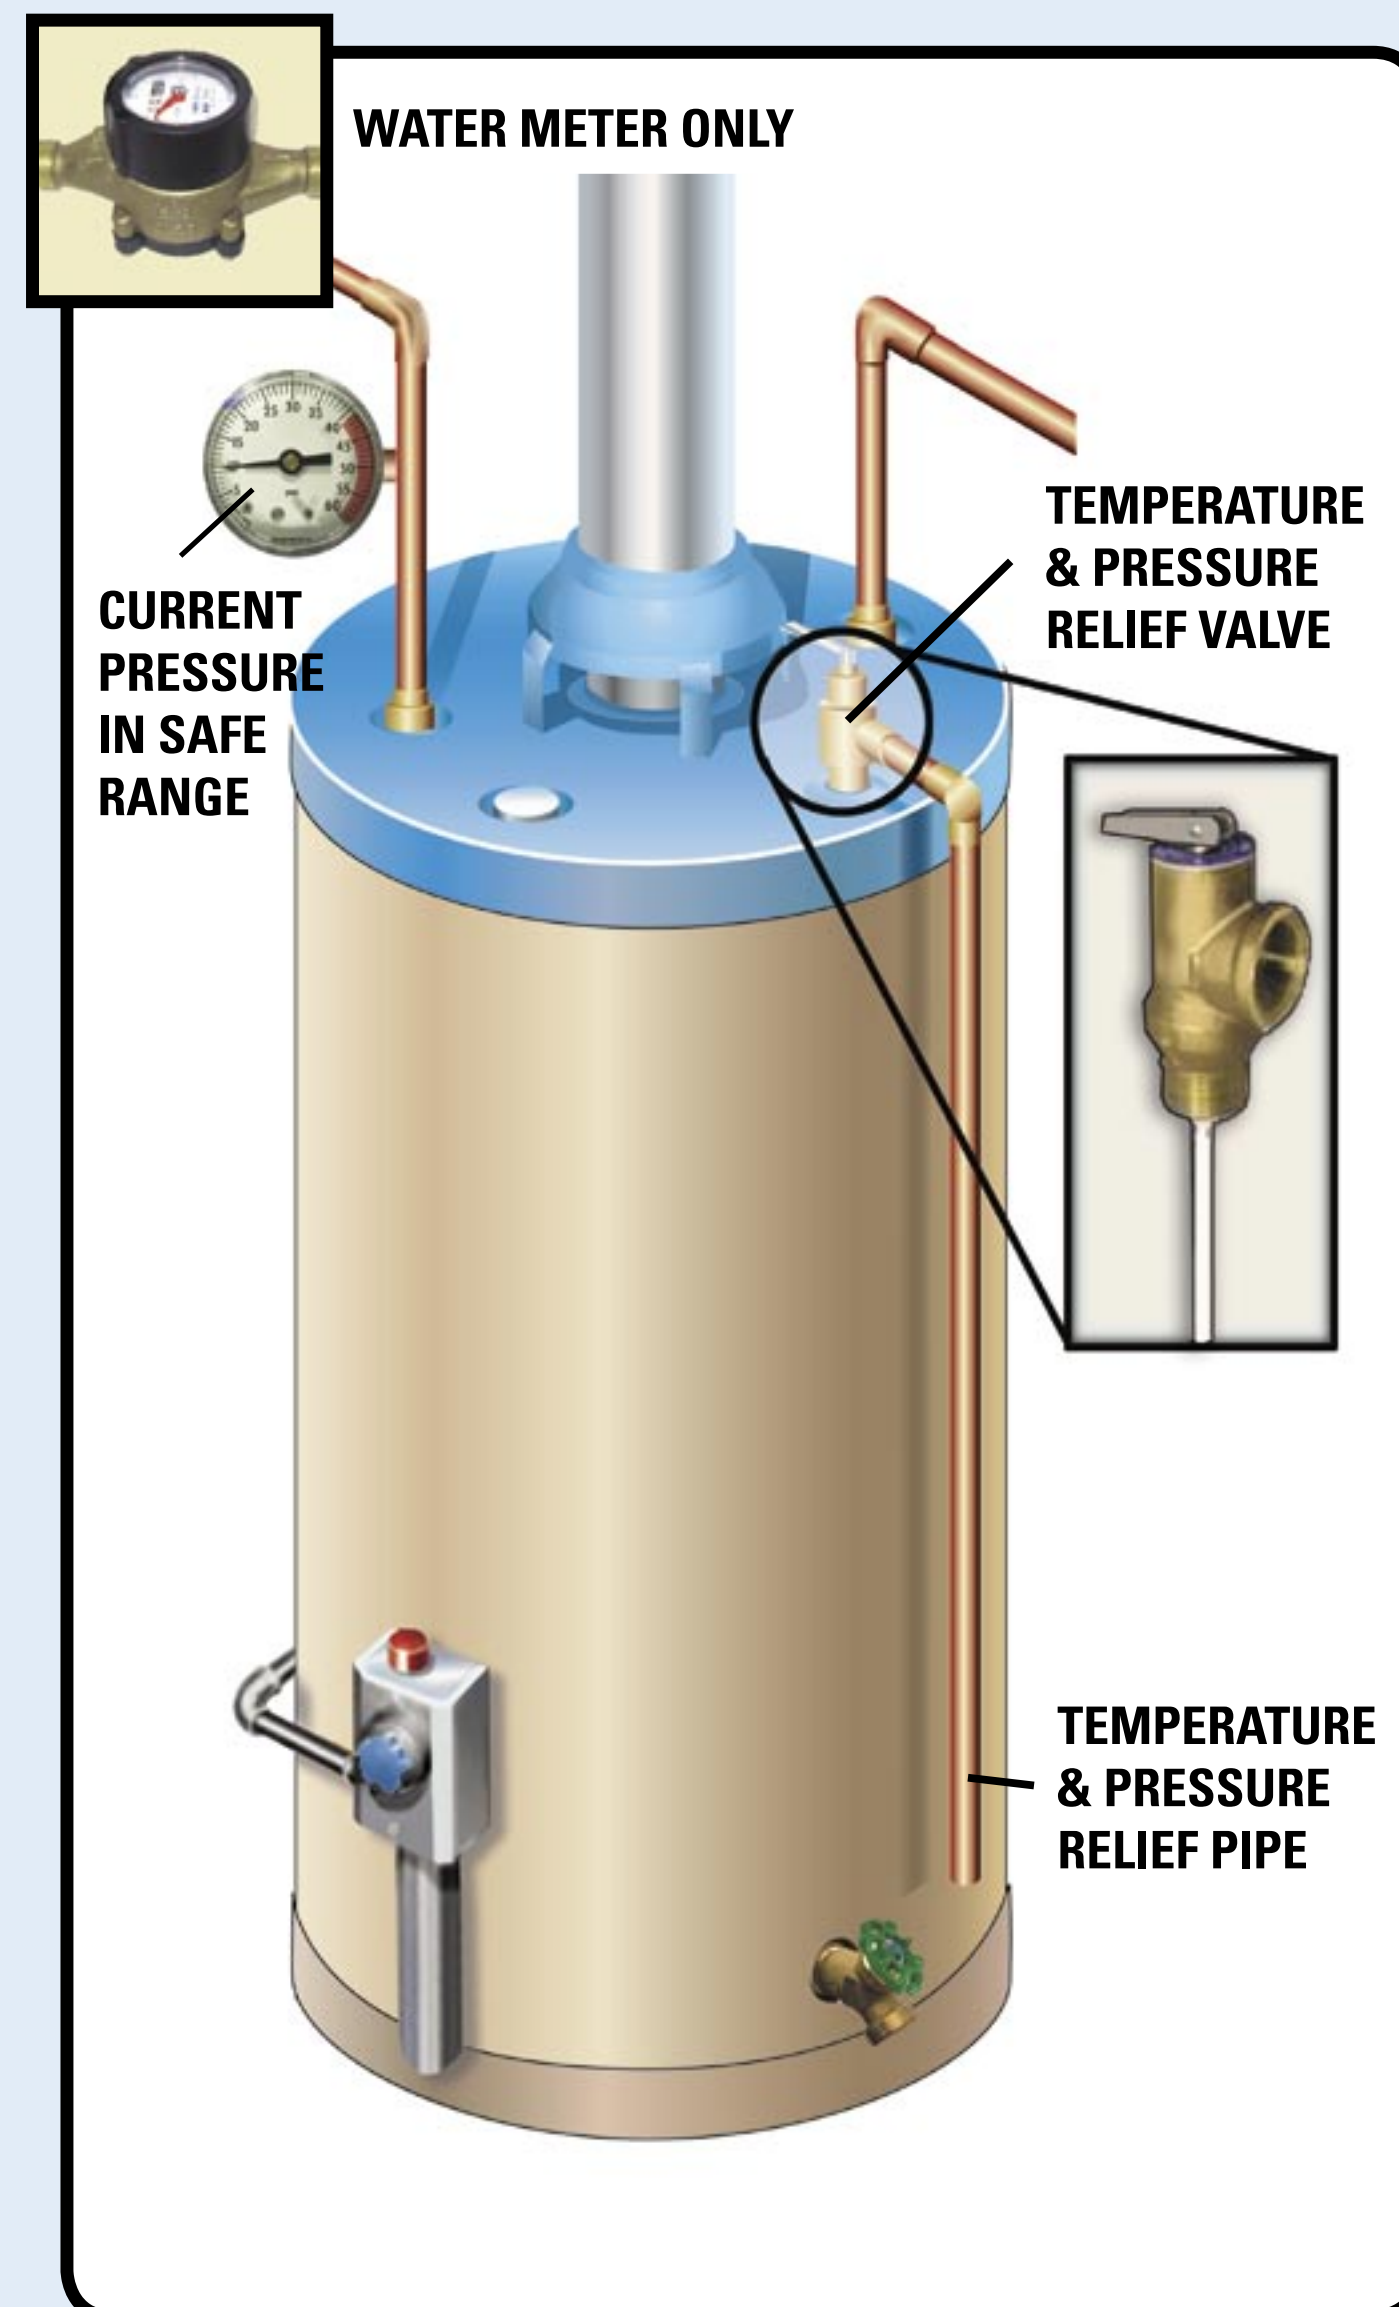


**CURRENT CONFIGURATION**

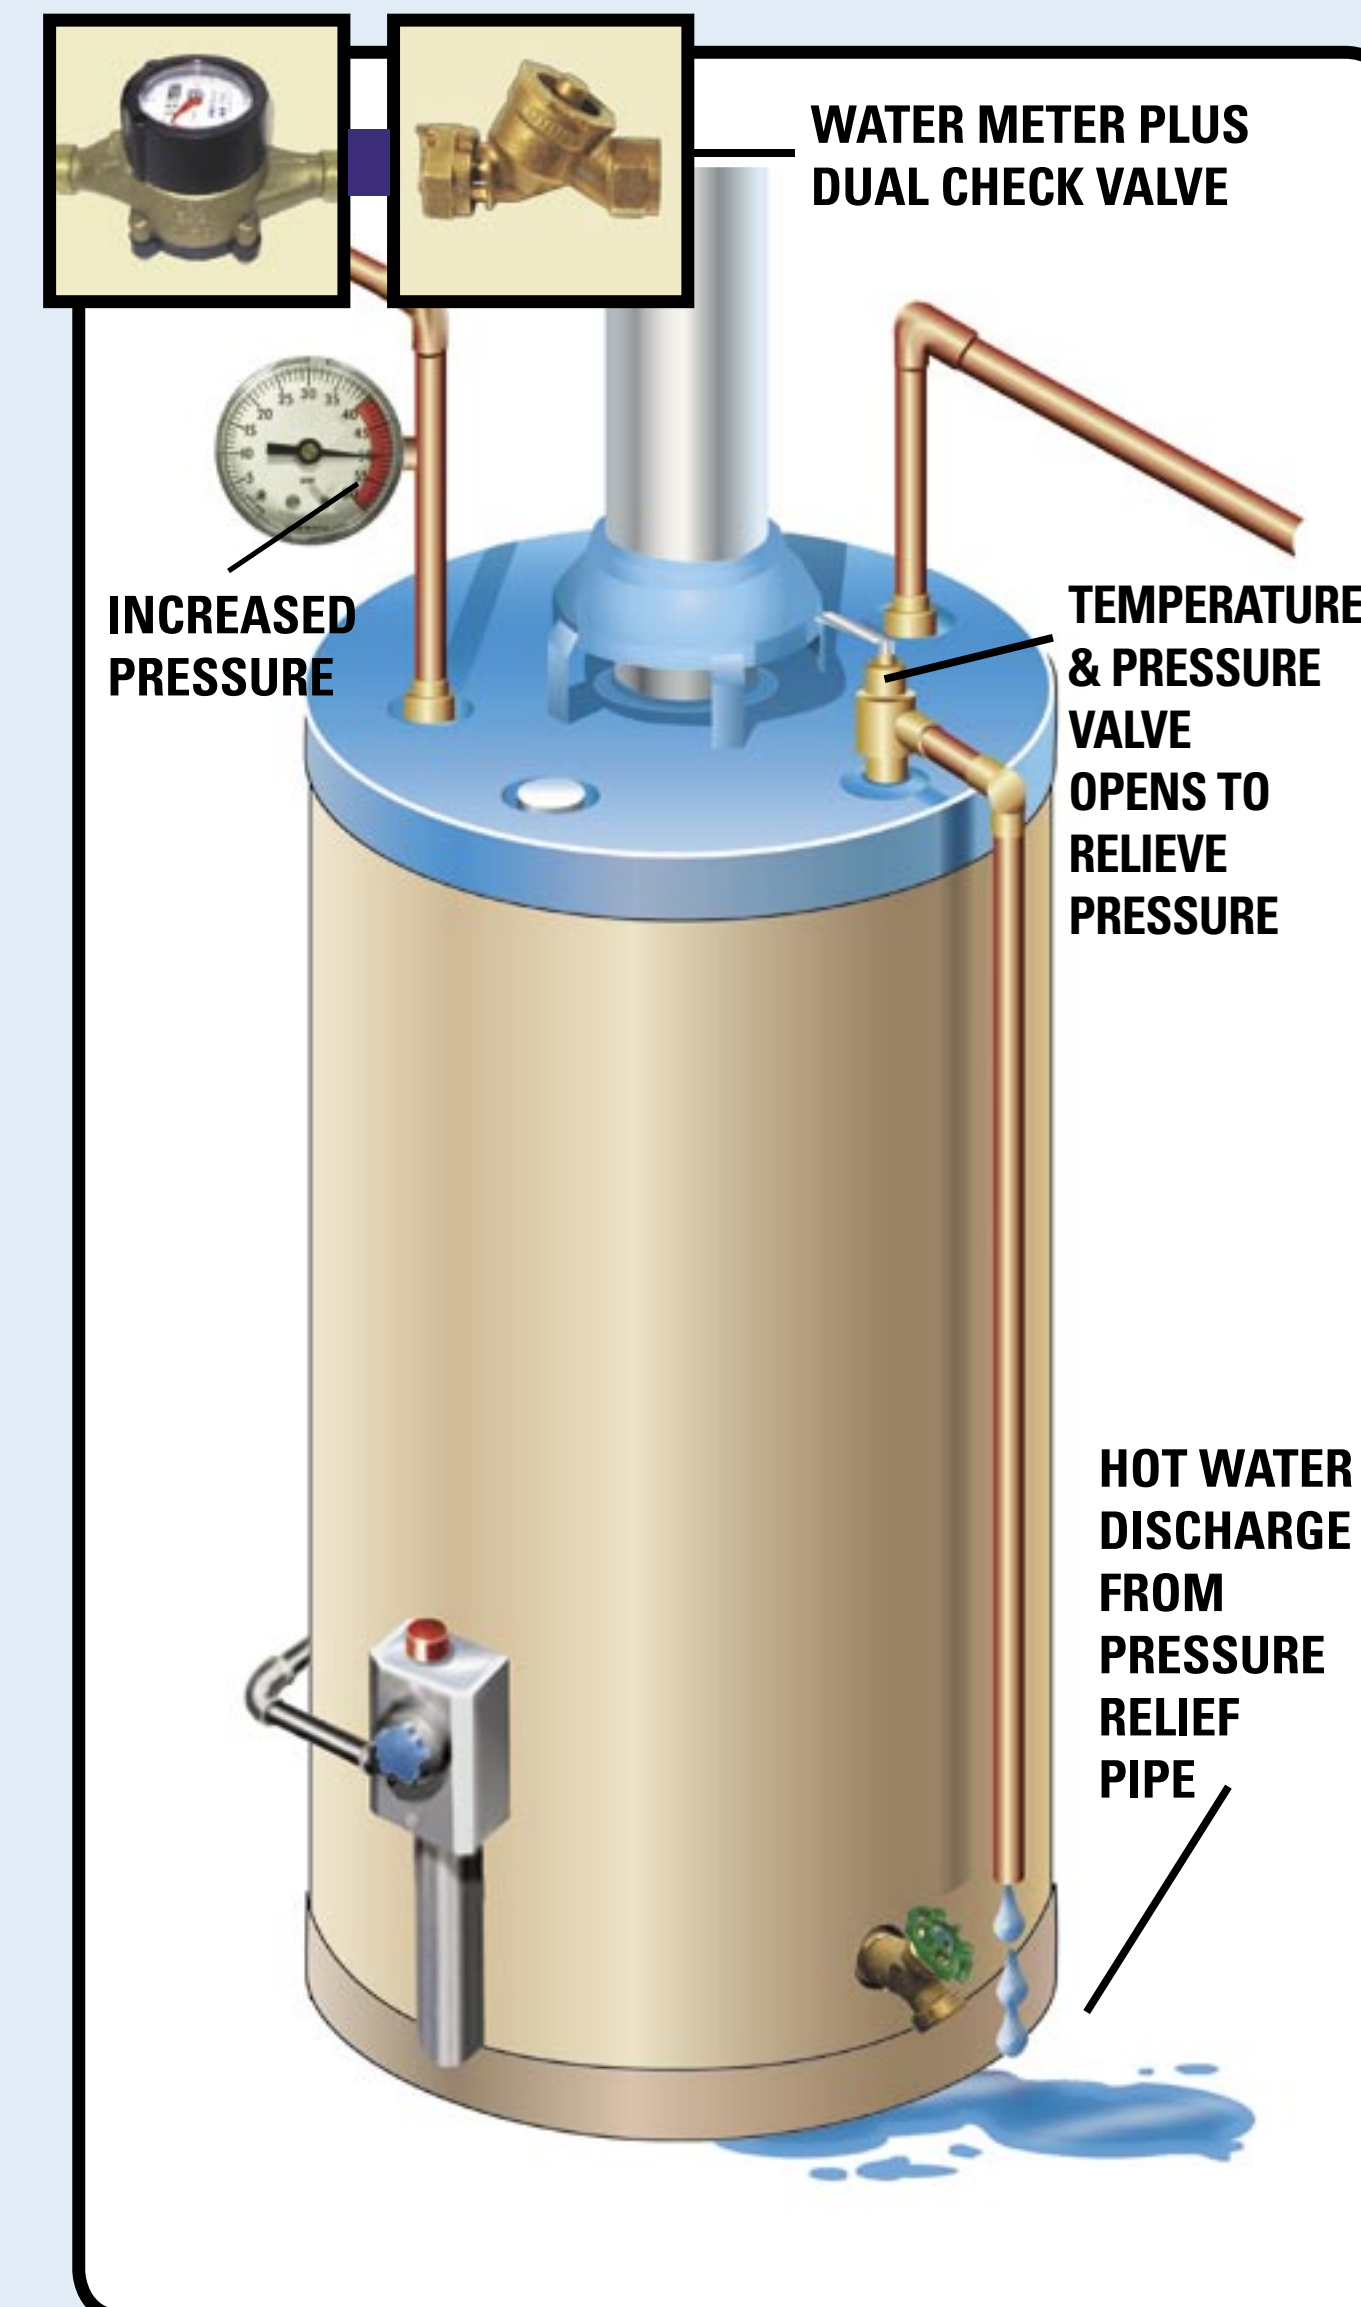

**DUAL CHECK VALVE INSTALLED AT METER**

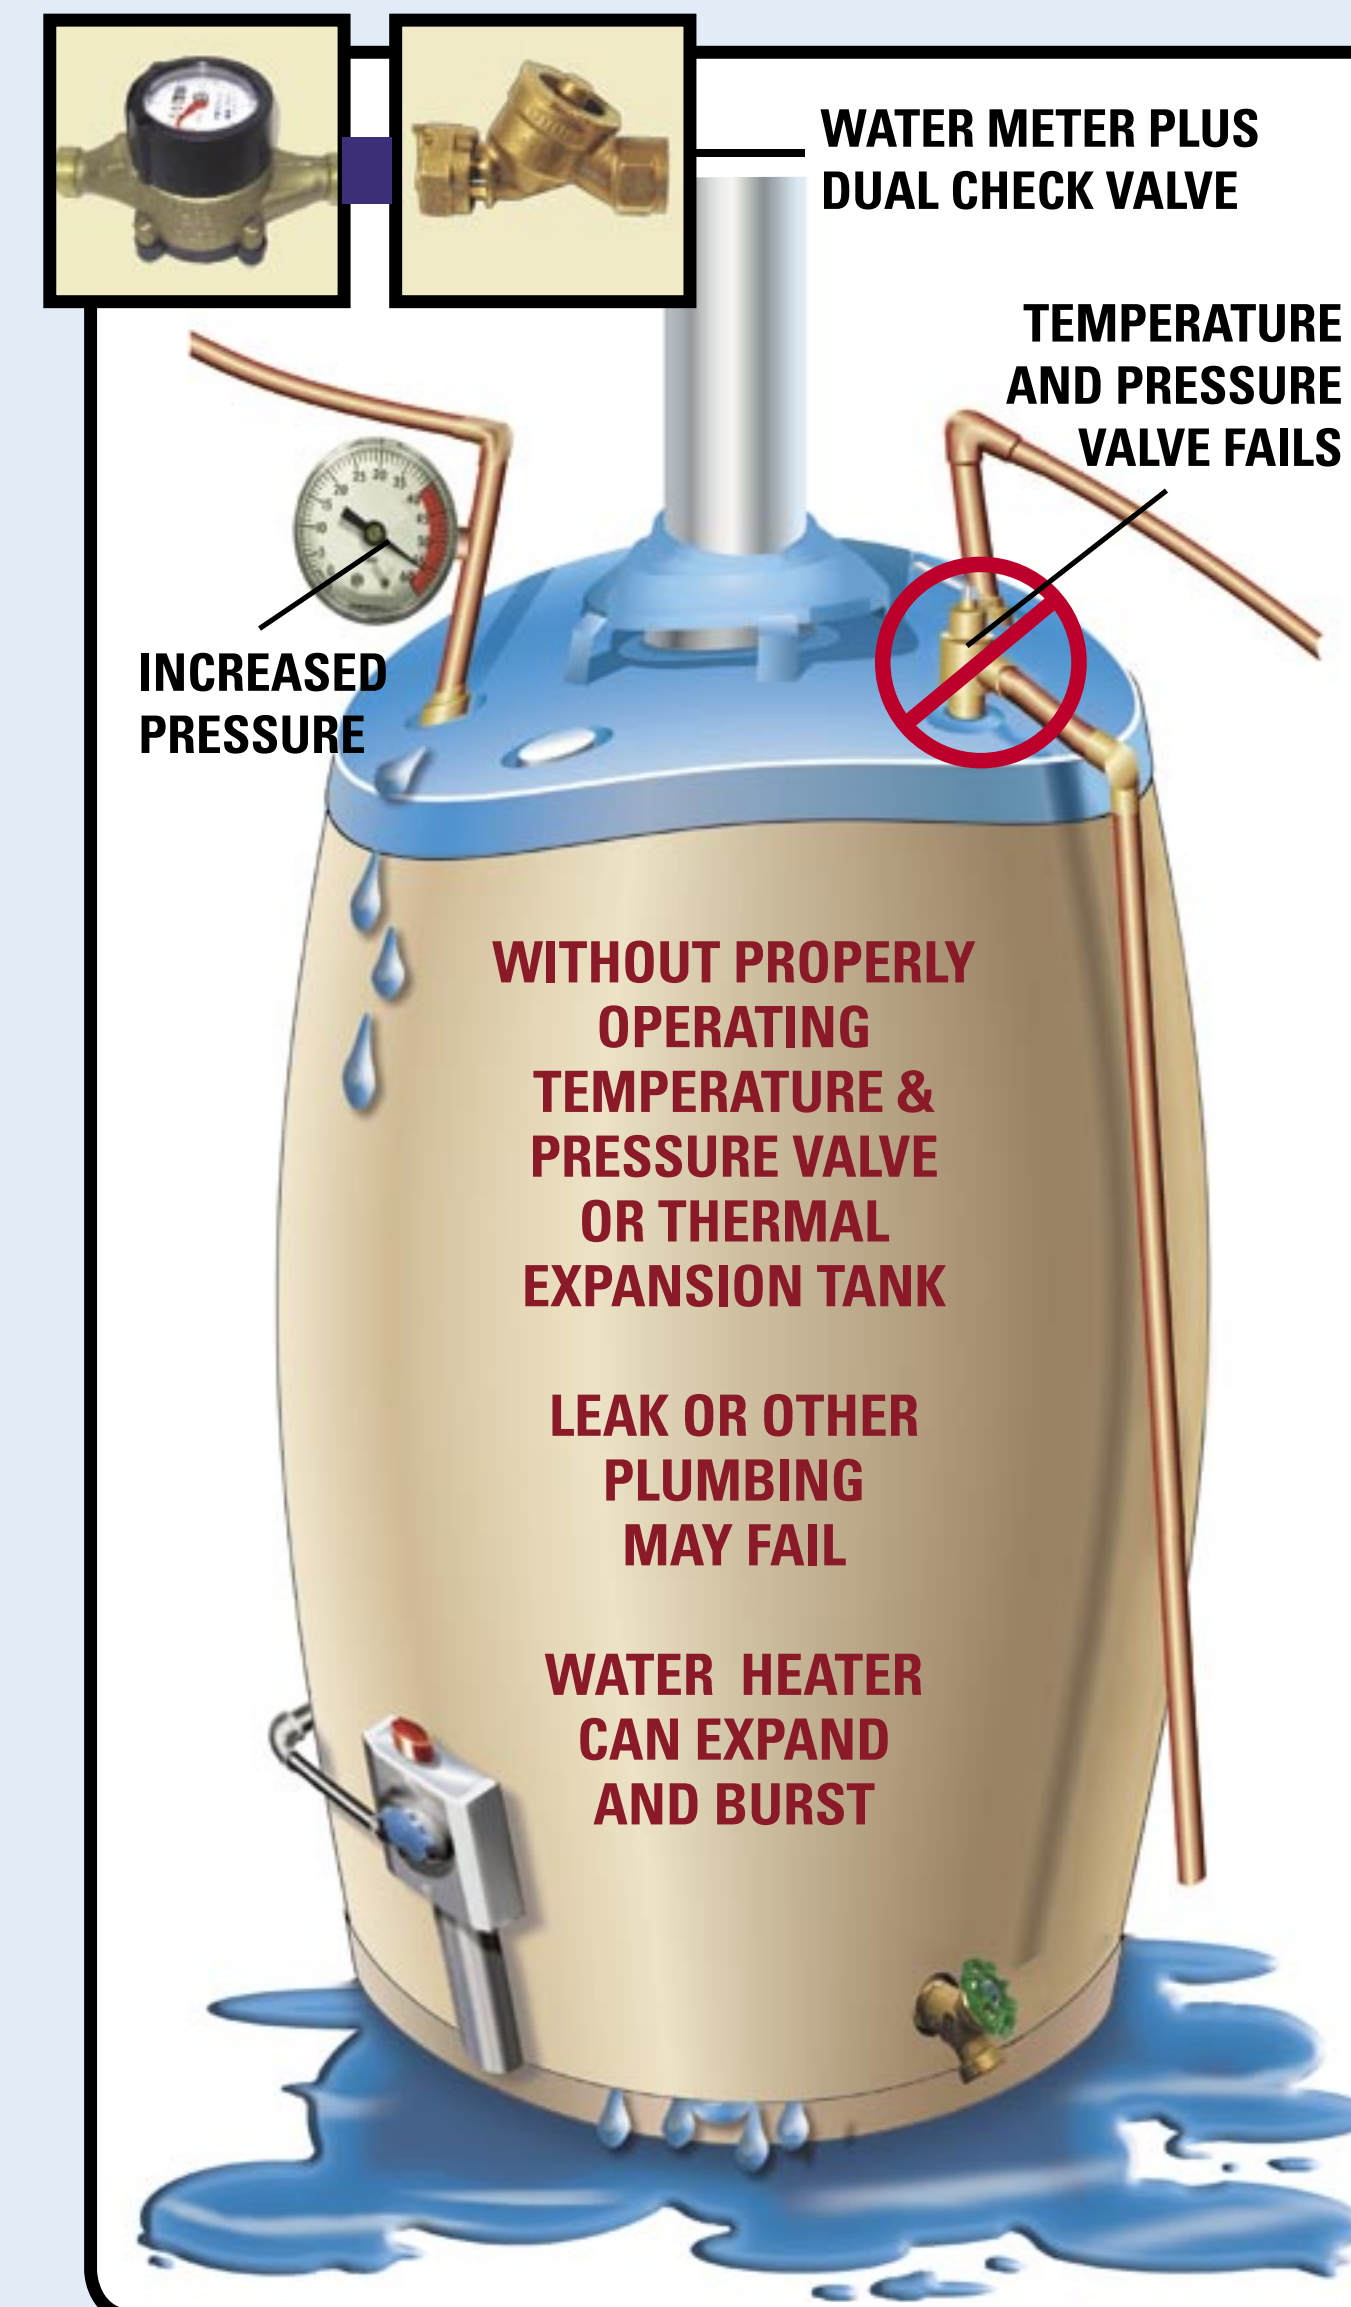

**DUAL CHECK VALVE WITHOUT THERMAL EXPANSION TANK TEMPERATURE AND PRESSURE RELIEF VALVE FAILS**

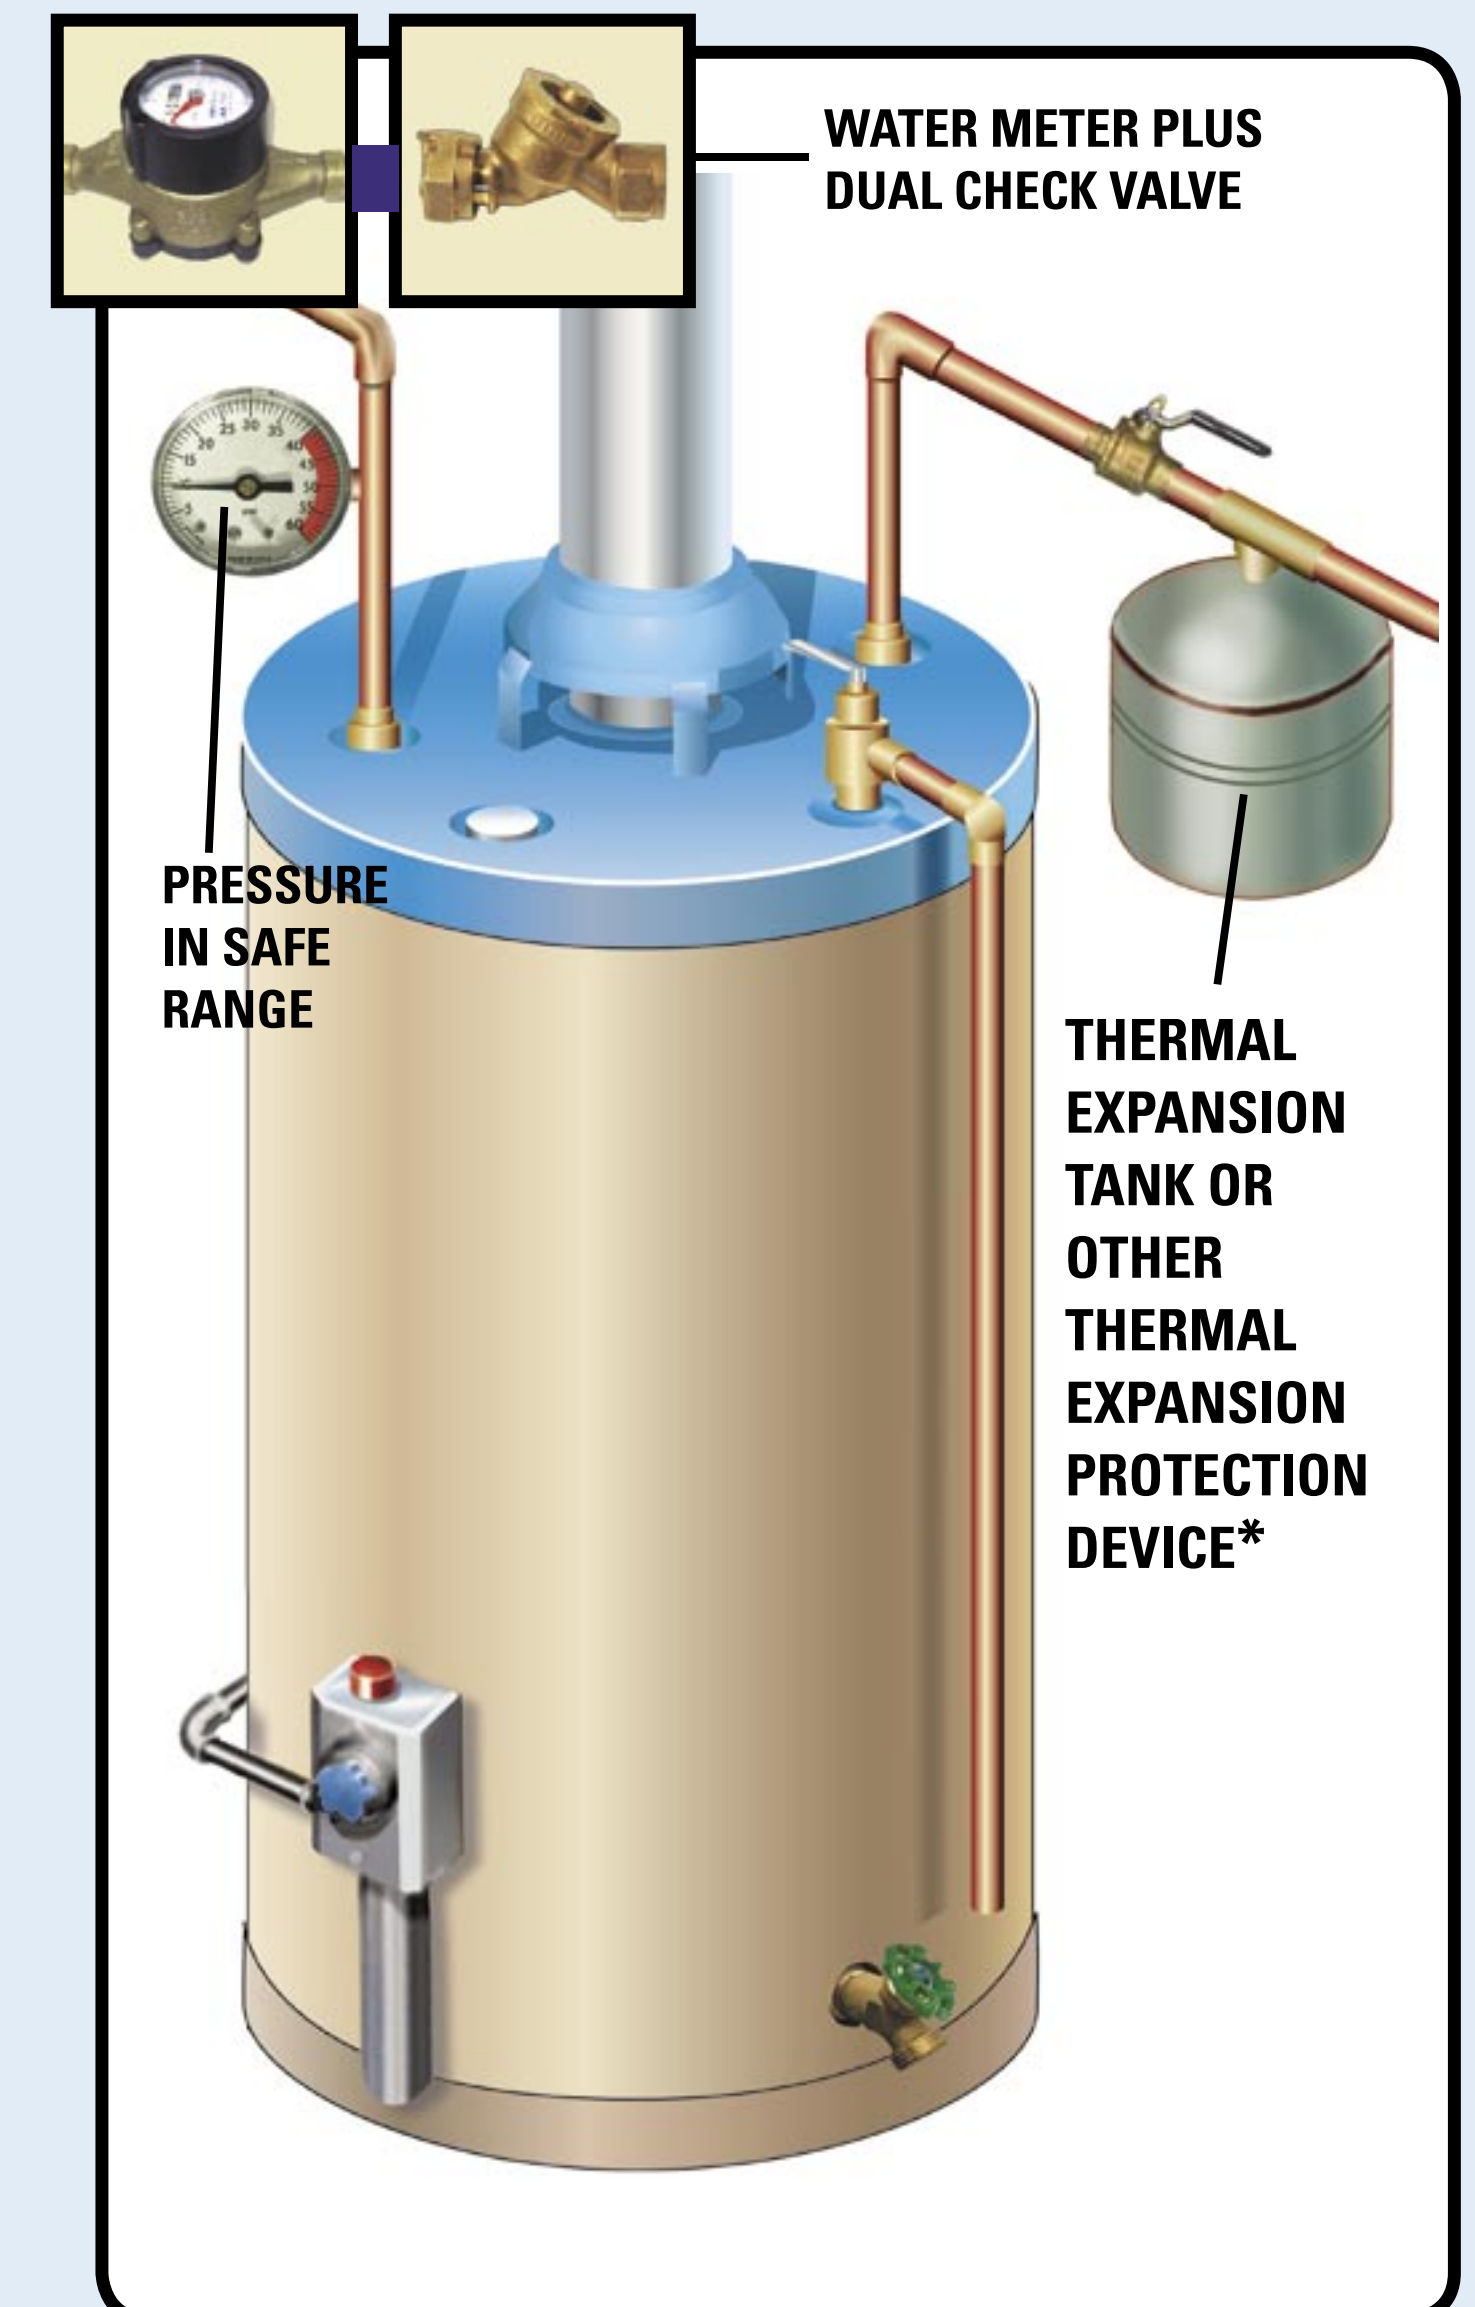

**DUAL CHECK VALVE AND THERMAL EXPANSION TANK INSTALLED**

\* THE PLUMBING CODE REQUIRES INSTALLATION OF A THERMAL EXPANSION PROTECTION (T.E.P.) DEVICE IF A DUAL CHECK VALVE IS INSTALLED AT THE METER. THE TEMPERATURE & PRESSURE VALVE CAN FAIL RESULTING IN PLUMBING DAMAGE IF NO T.E.P. DEVICE IS INSTALLED.