



October 6, 2025

Addendum #1 - IFB 25-048 Clarifier Sluice Gate for C.C. Williams

Prospective Bidders:

The above solicitation is amended as set forth below; bidders **MUST** acknowledge receipt of this addendum. **Please sign & return this form with your sealed bid.**

Please review the following changes/updates:

1. Page 3 – Part 2 Equipment – Item # 2.d.

Change: Gate shall be operated with electric actuator.

To: Gate shall be operated **by a Limitorque MXB-20 electric actuator provided by MAWSS.**

2. Page 3 – Part 2 Equipment – Item # 3.b.

The following language is to be added:

The frame shall be formed in one section with gussets that support unseating head pressure. Frames made of two sections bolted together are not acceptable.

3. Page 3 – Part 2 Equipment – Item # 3.e.

The following language is to be added:

e. The stem thread shall be rolled ACME with RMS finish of 16. Stub ACME or cut threads are not acceptable.

A copy of the revised pages is included. Changes are marked in red.

Printed Name

Date

Signature

Email Address

Company Name

Telephone Number

Company Address

City, State, Zip


Joyce Sawyer, Mayor II
Board of Water and Sewer Commissioners

INVITATION FOR BID
October 1, 2025
Revised October 6, 2025

INVITATION FOR BID NUMBER	IFB 25-048
NAME OF BID	Purchase of a Clarifier Sluice Gate for CC Williams WWTP
BIDS WILL BE RECEIVED AT	MAWSS Bid Box Donaghey Business Entrance 4725 Moffett Road Mobile, AL 36618 If sending bids by UPS/Fed Ex, deliver to the Warehouse: 1610 Shelton Beach Rd. Ext., Mobile, AL 36618
BID OPENING DATE	October 17, 2025
BID CLOSING TIME	10:30 am Central Time
AWARD WILL BE MADE BY	Total Cost & Lead Time
MATERIAL DELIVERED TO	CC Williams WWTP 1600 Yeend St. Mobile, AL 36603
ADDITIONAL INFORMATION CONTACT	Jed Barbour (251) 222-2363 Email: jbarbour@mawss.com Chris McCormack (251) 423-5684 Email: cmmccormack@mawss.com
APPLICABLE SDP POLICY	None

Sealed bids must be in the Purchasing Department no later than the time specified in order to be considered. Submissions received after the deadline will not be considered. Envelopes must bear the name of the supplier, company address and the words “IFB 25-048 Clarifier Sluice Gate” or “IFB 25-048 NO QUOTE.” Facsimile or email bids will not be accepted.

All bids must be submitted on the attached forms or your bid will be disqualified. Bidder shall furnish all the information required by the solicitation. The bidder’s name must be typed or printed on the bid sheet and signed by the bidder or appropriate authorized executive officer of the bidder’s company. Bidders must initial any changes or erasures. Bidders should retain a copy of bids for their records.

Bidders shall acknowledge receipt of all addenda to this solicitation by signing and returning each addendum or by identifying the addendum number and the date on the bid form. Failure to acknowledge receipt of any addendum by a bidder will result in rejection of the bid if MAWSS determines that the addendum contains information that materially changes the requirements.

All bids shall be quoted FOB Destination, freight prepaid with no additional charges. Unless otherwise specified in the bid, all prices will be on a firm-fixed price basis and are not subject to adjustments based on costs incurred. MAWSS reserves the right to reject any or all bids submitted, to waive any informality in any bid or in the bid process, or to terminate the bid process at any time, if deemed by MAWSS to be in MAWSS’s best interest.

A Purchase Order and this “Invitation for Bid” with “Specifications,” “Conditions,” “Bid Form,” signed by the successful bidder’s authorized representative, and all attached drawings and other documents furnished by MAWSS to the bidders with the Invitation for Bid in order to illustrate the contract requirements, will constitute a contract for the goods and/or services to be purchased.


Joyce Sawyer, Buyer II
Board of Water and Sewer Commissioners

IFB 25-048 CLARIFIER SLUICE GATE CONDITIONS

The Board of Water and Sewer Commissioners of the City of Mobile will accept bids for the **Clarifier Sluice Gate** in our Purchasing Department Bid Box located in the Business Entrance at 4725 Moffett Road, Mobile, AL. 36618 **no later than 10:30 a.m.** local time on **October 17, 2025**. Bids will be opened immediately after bid closing time in the Operations Center Board room located at the Customer Service entrance. Award will be by **Total Cost & Lead Time**. The bidder offers and agrees, if this bid is accepted, to furnish the items as defined in the specifications for the unit price set opposite each item. Pricing shall be FOB Mobile, Alabama. All items shall be delivered to **CC Williams WWTP located at 1600 Yeend St., Mobile, AL 36603**, or to the job site as needed. The bidder shall state the expected length of delivery time on the Bid Form.

An optional site visit can be scheduled before bidding. Please contact Jed Barbour at 251-222-2363 or Chris McCormack at 251-423-5684 to schedule a site visit.

Bidder understands and agrees that manufacturer and part numbers are provided for descriptive purposes only. Items of equal or better quality will be considered but must be approved by MAWSS in writing. Upon delivery, if the quality, durability or performance of any product represented as equal or better is determined by MAWSS to be unsatisfactory, MAWSS will require a suitable substitute or will require that the originally specified item be delivered, at the unit price originally offered by bidder. No substitution for items to be provided pursuant to this contract shall be permitted during the contract period without the express written consent of MAWSS. All items provided shall be for commercial use and for the purposes reflected in the contract documents.

No bid on closed out or discontinued item(s) will be accepted. Item(s) that have a determinable shelf life must be disclosed at the time of bid submittal. Bidder understands that his/her bid shall be good and may not be withdrawn for a period of sixty (60) calendar days after the scheduled closing time for receiving bids.

Bidder understands and agrees that quantities will be purchased by MAWSS on an "as needed" basis to replenish inventory. MAWSS shall not be committed to the purchase of a pre-established minimum quantity for any one item.

A bidder may not modify its bid after bid opening. Errors in the extension of unit prices stated in a bid or in multiplication, division, addition or subtraction in a bid may be corrected by the MAWSS Purchasing Buyer prior to award. In such cases, unit prices shall not be changed.

It is the responsibility of the bidder to determine prior to the bid opening whether any amendment, additions, deletions or changes of any type have been made to this Invitation for Bid, Conditions, Specifications, Bid Form or any of the other bid documents. Bid documents and any amendments made to this bid will be posted on our website at www.mawss.com.

Invoicing Requirements: MAWSS requires additional information for all work performed and services provided. On the vendor's invoice for payment should be a detailed listing of work performed, services provided, dates completed, locations involved, and any other pertinent information needed to verify the work and/or services were completed in accordance to the bid specs. This additional information can be supplied in the form of detailed invoices, work orders, checklists or any other documents used to track the work performed or services provided but details must be included on the actual invoice. A copy of the invoice and these additional details must be sent to the "ADDITIONAL INFORMATION CONTACT" found on Page 1 of the bid documents and a copy emailed to Accounts Payable at AcctsPayable@mawss.com.

END OF CONDITIONS

**IFB 25-048 CLARIFIER SLUICE GATE
SPECIFICATIONS**

PART 1 – GENERAL

1. SCOPE

- a. The purpose of this bid is to provide specifications for one fabricated sluice gate and guide rail system for Final Clarifier #4 at the Clifton C. Williams Wastewater Treatment Plant.

PART 2 – EQUIPMENT

1. EQUIPMENT

- a. Equipment shall be a fabricated weir gate by Hydro Gate Corporation or approved equivalent.

2. SLUICE GATE

- a. Gate dimensions shall be 72” W x 48” H
- b. Gate shall be fabricated from 316 stainless steel material.
- c. Gate shall be supplied with all installation appurtenances, fasteners, fittings, and/or materials that are required for the gate to be functional after installation.
- d. Gate shall be operated ~~with electric actuator~~ by a Limitorque MXB-20 electric actuator provided by MAWSS.
- e. Gate shall be drop-in replacement for existing aluminum sluice gate.
 - i. Bidder to coordinate with owner on site visit to verify measurements and details of fabrication.

3. SLUICE GATE FRAME

- a. Frame shall be fabricated from 316 stainless steel material.
- b. Frame shall be fabricated as a self-contained frame with polymer bearing bars in guide grooves, UHMW seals, and downward opening slide. **The frame shall be formed in one section with gussets that support unseating head pressure. Frames made of two sections bolted together are not acceptable.**
- c. Frame shall have the capacity to be mounted to existing walls with stainless steel anchor bolts per provided drawing.
- d. Frame shall be a drop-in replacement for existing aluminum sluice gate frame.
- e. **The stem thread shall be rolled ACME with RMS finish of 16. Stub ACME or cut threads are not acceptable.**

PART 3 – INSTALLATION

1. INSTALLATION

- a. MAWSS to supply contractor for installation of sluice gate frame and sluice gate.

PART 4 – TRANSPORTATION

1. TRANSPORTATION


- a. Equipment shall be delivered undamaged to the Clifton C. Williams Wastewater Treatment Plant located at 1600 Yeend St., Mobile, AL 36603.
- b. Notice shall be given 24 hours prior to delivery to Jed Barbour, who can be contacted at (251) 378-3513, or Chris McCormack, who can be contacted at (251) 423-5684.
- c. Transportation costs shall be included in bid pricing – no additional transportation costs shall be paid by MAWSS.
- d. Bidder is responsible for delivering and unloading equipment on-site in new and undamaged conditions.
- e. The bid items shall be delivered to the Owner within 12 weeks of issuance of order and order to proceed as per bid specifications.

PART 5 – WARRANTY

1. WARRANTY

- a. Bidder shall provide a 2-year full replacement warranty on all materials and workmanship, not including installation.

END OF SPECIFICATIONS

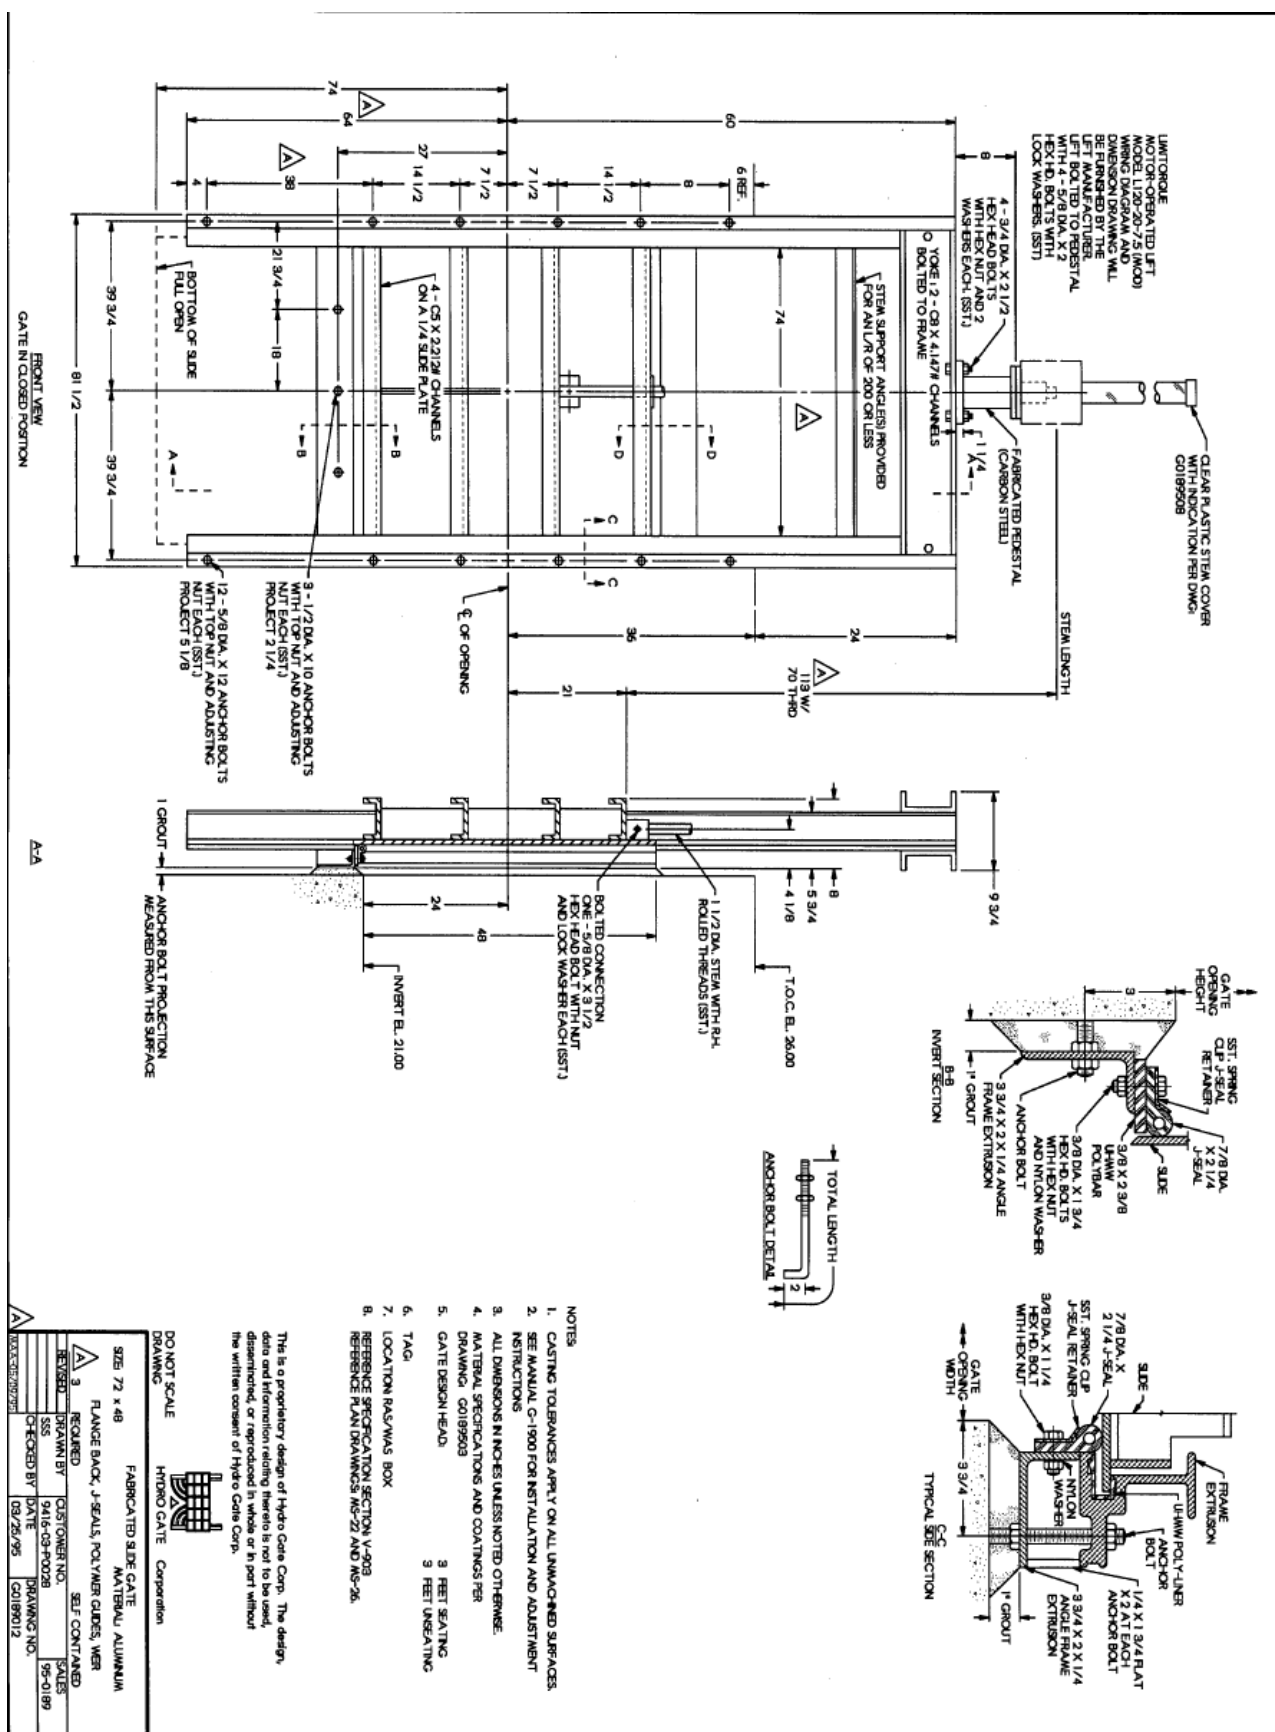

**IFB 25-048 CLARIFIER SLUICE GATE
BID SHEET**

Total Cost* \$ _____

*Must include all charges, including but not limited to warranty and freight charges, if applicable.

Delivery (ARO): _____
(After receipt of order)

Company Name _____ **Payment Terms** _____

Address _____

City, State, Zip _____

Submitted By _____ **Title** _____
Please Print

Phone _____ **Email Address** _____
Please Print

The signer declares under penalty of perjury that she/he is authorized to sign this document and bind the company or organization to all terms and conditions of this agreement.

Signature _____ **Date** _____